



## APRIL 2023 MONITORING DATA

### Notes on Monitoring Data

Environment Protection Licence: 11781

Date Published: 31 May 2023

Date Sampled: 1, 4, 5, 7, 12, 13, 14, 20 April 2023

Date Sample Results Released: 10 May 2023

In relation to the monitoring data, IPL notes:

- The automatic sampler only triggers when a specified volume of rainfall has occurred. Sampling is currently initiated when the following two conditions are met:
  - A minimum 2 mm rainfall depth is measured in the preceding 60-minute period by the tipping bucket rain gauge; and
  - Stormwater flow over is detected by the flow sensor installed inside the drainage line.
  - Provided these conditions continue to be met, stormwater is sampled from the monitoring pit every 15 minutes and stored in sample bottles housed in a carousel within the auto sampler unit.
- Prior to analysis of collected stormwater samples “composite stormwater samples” are produced. Composite sampling consists of a collection of numerous individual discrete samples collected in a common container over a sampling period. Composite samples are collected from the discharge point and sent for analysis. The current sampling period is ‘per rainfall event’. This is defined as a continuous period where the flow and rainfall conditions are continued to be met and the time between sample collection is 15 minutes.
- EPA Licence 11781 sets no specific pollutant limit on the site’s water discharges.
- IPL Newcastle has recently concluded the improvement works conducted within the Northern Drain network. These works included the diversion of clean roof water and the re-lining of all existing stormwater pipes. All stormwater flow is now diverted to the Central drain.
- **Figure 1** summarises the rainfall for April 2023.

## APRIL 2023 MONITORING DATA

### Central Drain Storm Water Drainage Analysis (EPL 7)

Pollutant	Units of Measure	Monitoring Frequency Required	No of Samples Analysed in month	Min. Value	Mean Value	Median Value	Max. Value
pH	pH Unit	Monthly during discharge	11	6.35	6.86	6.88	7.05
Total Suspended Solids	mg/L	Monthly during discharge	11	<5	52.1	35.0	145
Sulfur as S	mg/L	Monthly during discharge	11	50.0	236	170	680
Sulfate as SO <sub>4</sub>	mg/L	Monthly during discharge	11	54.0	236	182	636
Total Zinc	mg/L	Monthly during discharge	11	0.09	0.72	0.48	2.58
Ammonia as N	mg/L	Monthly during discharge	11	23.7	94.6	88.2	235
Nitrite as N	mg/L	Monthly during discharge	11	0.17	0.82	0.58	3.07
Nitrate as N	mg/L	Monthly during discharge	11	3.05	6.52	6.12	10.9
Nitrite and Nitrate as N	mg/L	Monthly during discharge	11	3.5	7.3	6.6	11.4
Total Kjeldahl Nitrogen as N	mg/L	Monthly during discharge	11	34.1	191	186	451
Total Nitrogen as N	mg/L	Monthly during discharge	11	40.7	198	190	461
Phosphorus (Total) as P	mg/L	Monthly during discharge	11	17.2	57.6	54.1	121
Phosphorus (Reactive) as P	mg/L	Monthly during discharge	11	14.8	55.6	49.3	110
Phosphate (Calculation from Total Phosphorus)	mg/L	Monthly during discharge	11	52.9	177	166	371

Not detected values defined as half the detection limit for the purpose of calculating the mean and median.

### Rainfall & Flow Data


Each drain has a rain gauge and flow sensor. The rain gauge and flow sensor transmit the rain and flow information to a controller which then initiates the automatic sampler to take a sample in accordance with the site's EPL licence (EPL 11781).

Flow rate information is recorded on a continual basis via flow sensors located inside the discharge drain. A magnetic flow sensor has recently been installed to measure the flow at the Central drain.

A rainfall gauge independent to the ISCO samplers is also located on site. It is noted that the April data was incomplete due to power interruptions and therefore RCA have utilised the data from the Bureau of Meteorology Nobbys station as shown Nobbys station as shown in **Figure 1** below.



## APRIL 2023 MONITORING DATA

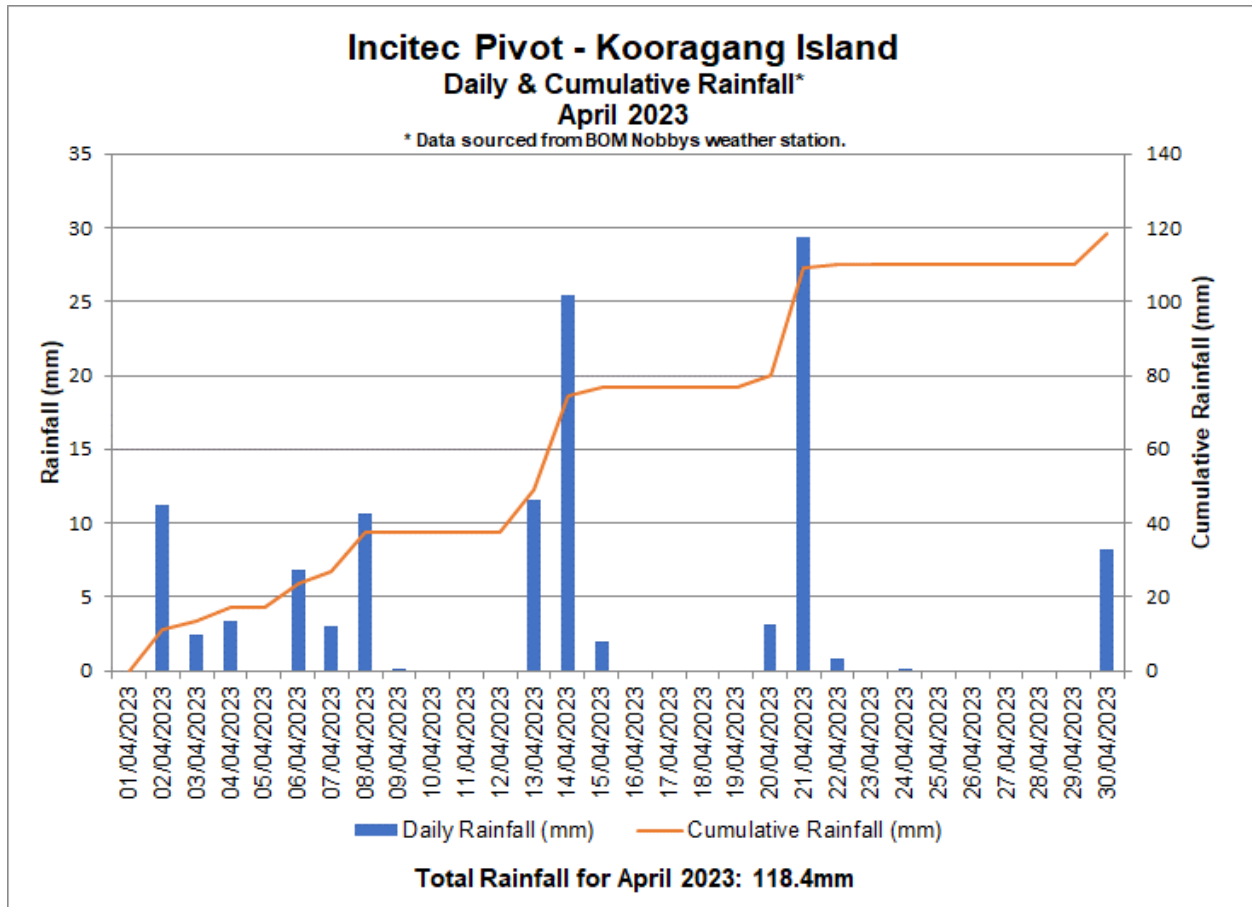

**Figure 1** April 2023 Rainfall Summary